Typical Sampling Manhole Plan

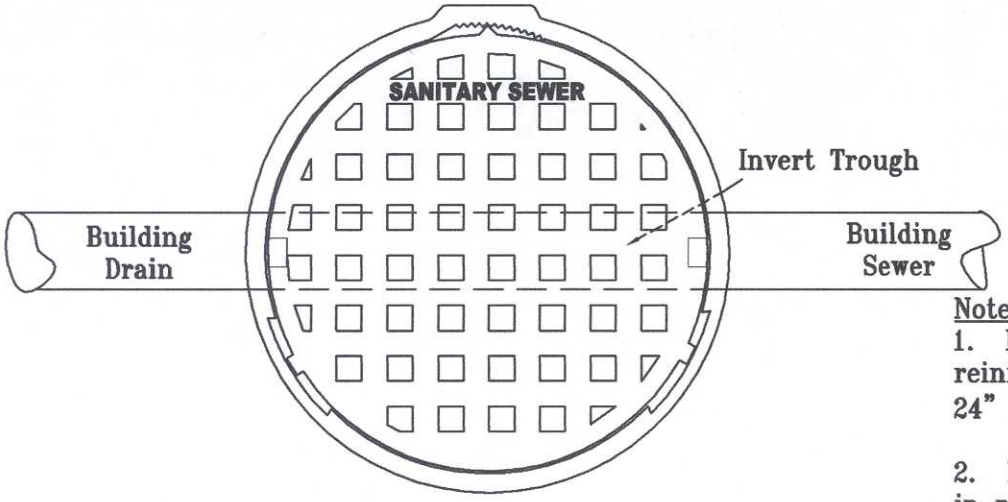

Notes

1. Manhole shall be standard reinforced concrete pipe section, 24" I.D. x 4'-0".

2. Manhole floor shall be poured in place concrete.

3. Frame & lid shall be Neenah Slab Type R-5900-E or equal.

4. RamNek shall be applied under entire portion of the frame and at all concrete pipe joints.

5. Opening for influent and effluent pipe to be cored without breaking. Use "Inserta-Lok" or approved equal for pipe connection to manhole.

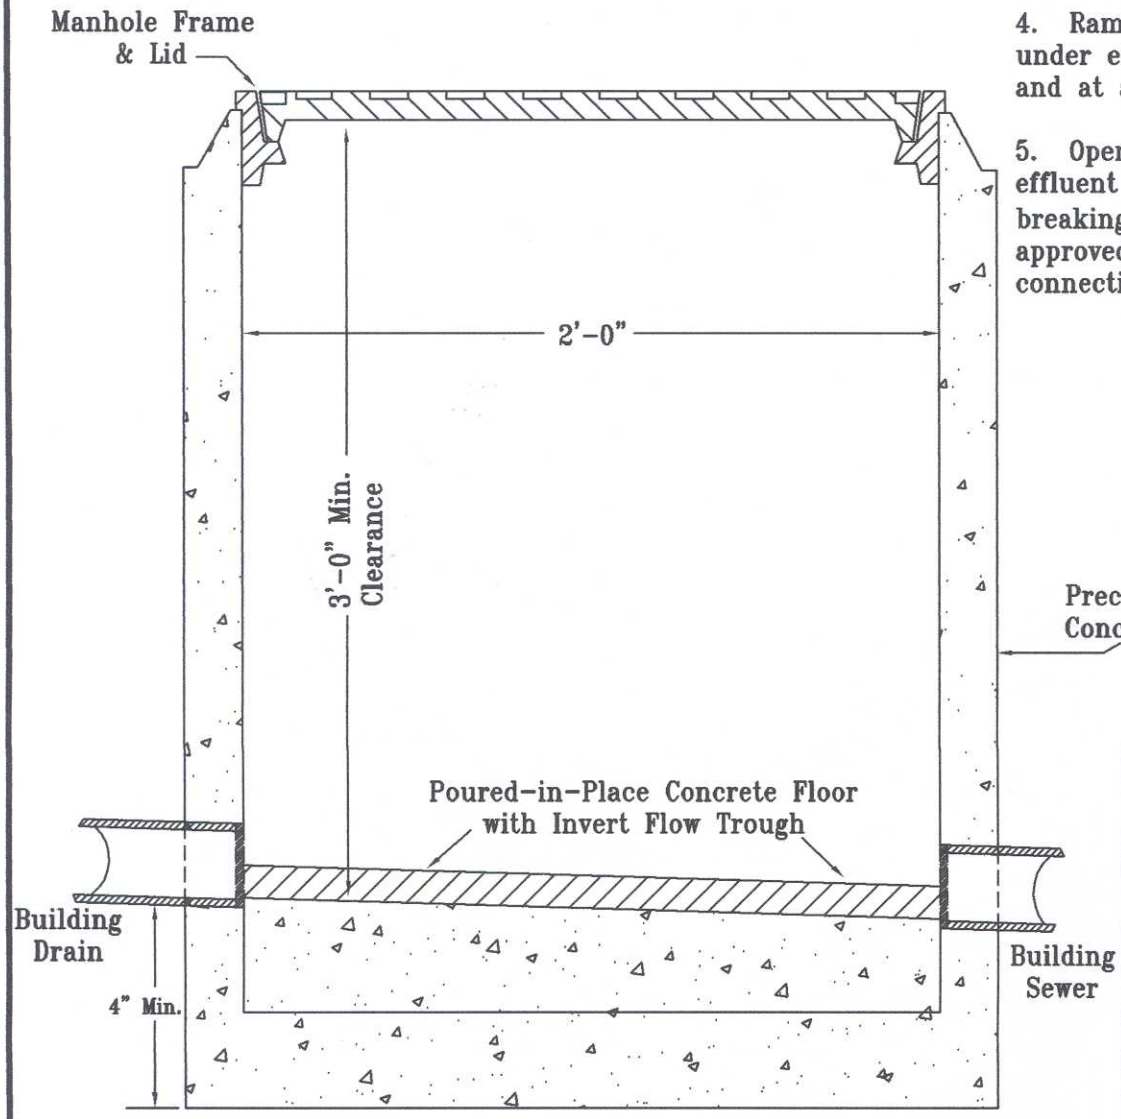

CITY of SPRINGFIELD

DWG NO.	
Typical Sampling Manhole	
REV. 22 Feb 06	Scale: None